

CUSTOMER REFERENCE

## MYSTIC ISLE

Sample description as provided by customer

Mass/unit area **50 oz/yd<sup>2</sup>** g/m<sup>2</sup> Pile Fibre Content **100%RESISTAIN SOLUTION DYED NYLON**

Construction Details **Tufted** Secondary Backing **Jute**

Style **Cut Pile**

Order No. **10175**

Colour **Dark Grey**

Pile Height **12 mm**

**TEST METHOD AS/ISO 9239.1 2003 Reaction To Fire Tests For Floorings Part 1 Determination of the Burning Behaviour Using a Radiant Heat Source. As required by specification C1.10a of the Building Code of Australia.**

Tested in accordance with the Carpet Institute Code of Practice for AS/ISO 9239 Testing Version 10 / 0805.

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test, they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use. Clause 9 of AS/ISO 9239 Part 1

Conditioning as specified in BS EN 13238.2001

Sample submitted Date **6/12/2006.**

Test Date **21/12/2006.**

## ASSEMBLY SYSTEM OVER UNDERLAY details below.

The UNDERLAY used was DUNLOP EXCELLAY.

Substrate : Non-combustible

Substrate – 6mm Fibre Reinforced Cement Board to simulate a Non-Combustible Flooring.

Sample Cleaned as Specified in ISO 11379.1997

Initial Test Specimen 1 Length Direction Critical Radiant Flux 5.9 kW/m<sup>2</sup>  
Specimen 1 Width Direction Critical Radiant Flux 6.8 kW/m<sup>2</sup>  
Full tests carried out in the Length Direction


SPECIMEN	Length #1	Length #2	Length #3	Mean
Critical Radiant Flux (kW/m <sup>2</sup> )	5.9	5.9	6.6	6.1
Smoke Development Rate (%.min)	293	269	247	270

The values quoted below are as required by Specification C1.10a Fire Hazard Properties (Floors) of the Building Code of Australia.  
The Critical Radiant Flux quoted is the value at Flame-Out.

## MEAN CRITICAL RADIANT FLUX 6.1 kW/m<sup>2</sup>


## MEAN SMOKE DEVELOPMENT RATE 270 %.min

OBSERVATIONS The samples melted away from the heat source then ignited

**NATA**  
ACCREDITED FOR  
TECHNICAL  
COMPE TENCE

Authorised Signatory **M. B. Webb**  
Date **21/12/2006.**

NATA Reg. No. 15393  
Heat and temperature measurement.



PAGE 1 of 2

Page 2 only shows the time required in seconds for the flame front to reach each time marker, the total test time and the CHF value at 30 minutes (if applicable).

The laboratory allows the use of this page of the report without the use of page 2.

1001 01 06

**Pyrometer temperature**  
 On calibration 528.7°C  
 Start of test run 529.3  
 End of test run 529.8


**Chamber temperature**  
 On calibration 91.0°C  
 Start of test run 89.6  
 End of test run 89.3

Clause 7.2.2 AS/ISO 9239 The pyrometer should be  $\pm 5^\circ$  of calibration temperature.  
 The Chamber temperature should be  $\pm 10^\circ$  of calibration temperature  
 The Holding Tension on Specimen Frame was 1 Nm

**TIME FOR EACH SPECIMEN TO REACH EACH MARKER IN SECONDS**

Specimen	50	60	110	160	210	260	310	360	410	460	510	560	610	660	710	760	810	860
1	171	182	297	351	456	522	618	835	/									
2	169	202	322	432	487	538	617	945	/									
3	159	243	319	385	435	513	575	/										

**FLUX CALIBRATION: FLX06003**

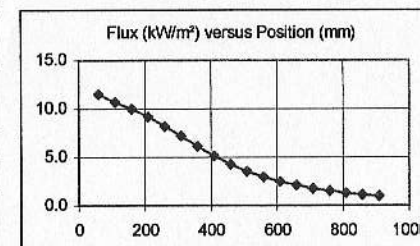

**TESTS**

Specimen	SMOKE PRODUCTION		BURNING CHARACTERISTICS		
	Maximum Light Attenuation (%)	Smoke Development Rate (%.min)	Burn Length at Flame Out (mm)	Time To Burn Out (s)	Critical Heat Flux at 30min (kW/m²)
Initial Test: <b>Width</b>	42	255	330	1,436	(n/a)
Specimen Tests: <b>Length</b>					
1	53	293	370	1,271	(n/a)
2	48	269	370	1,425	(n/a)
3	50	247	340	894	(n/a)
Mean	50	270	360	1,197	

ACCREDITED FOR  
**TECHNICAL  
 COMPETENCE**

NATA Reg. No. 15393  
 Heat and temperature measurement.

Authorised Signatory  
**M B Webb**  
 Date 21/12/2006

**PAGE 2 of 2**

The laboratory does not allow the use of this page of the report without the use of page 1.  
 This page alone has no validity under specification C1.10a Fire Hazard Properties (Floors) of the Building Code of Australia.

2001 01 06 9614 06120144-0143-0145-0146